

5051-11418

ADDENDUM NUMBER 1

GENERAL MITCHELL INTERNATIONAL AIRPORT
HOT WATER BOILER REPLACEMENT
GMIA POWER PLANT
Site #290, Bldg. #220
5300 South Howell Avenue
Milwaukee, WI 53207

Project Number: 5051-11418


Date of Addendum: February 18, 2011

This Addendum to the Contract Documents is issued to modify, explain or correct the original documents, dated February 1, 2011, and is hereby made part of the Contract Documents. Acknowledge receipt of this Addendum in the space provided on the Bid Form, or bid may be rejected.

DRAWINGS

Refer to the attached drawing SK-1 Equipment Pad Extension Detail.
Contractor shall install concrete pad extension as indicated in the detail.
Contractor shall submit a mix design for review.

End of Addendum No. 1

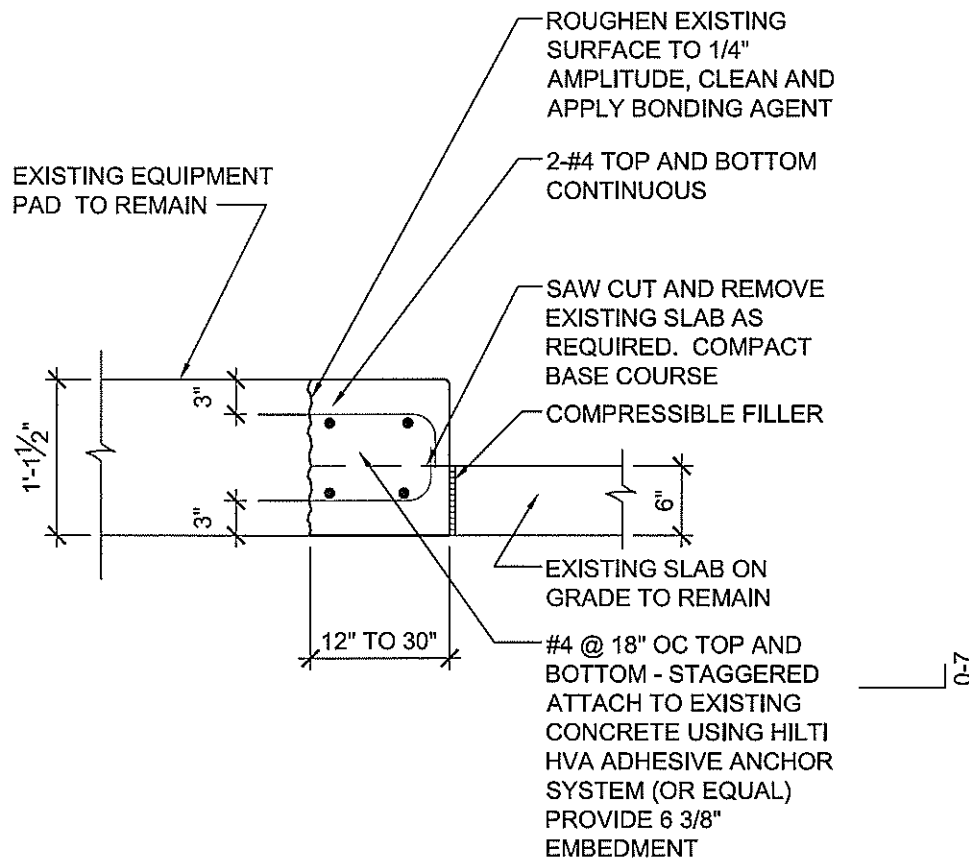

DESIGN CRITERIA

CONCRETE _____ $f_c = 3000$ PSI (AT 28 DAYS) COMPACT BASE

REINFORCEMENT STEEL _____ ASTM A615 GRADE 60

1 EQUIPMENT PAD EXTENSION DETAIL
SK-1 SCALE: 3/4"=1'-0"

SK - 1

DATE 02/15/11
 SCALE NOTED
 DRAWN ISE
 APPROVED _____
 G/BA PROJECT 11012

General Mitchell International Airport
 Hot Water Boiler Replacement
 Heating Plant Building

Grumman/Butkus Associates
 Energy Consultants and Design Engineers

1011 North Mayfair Road, Suite 300
 Wauwatosa, Wisconsin 53226
 414 476.8980

